


Weekly Report


2017-11-03

Kim, Hanbeom

Geant4 Simulation

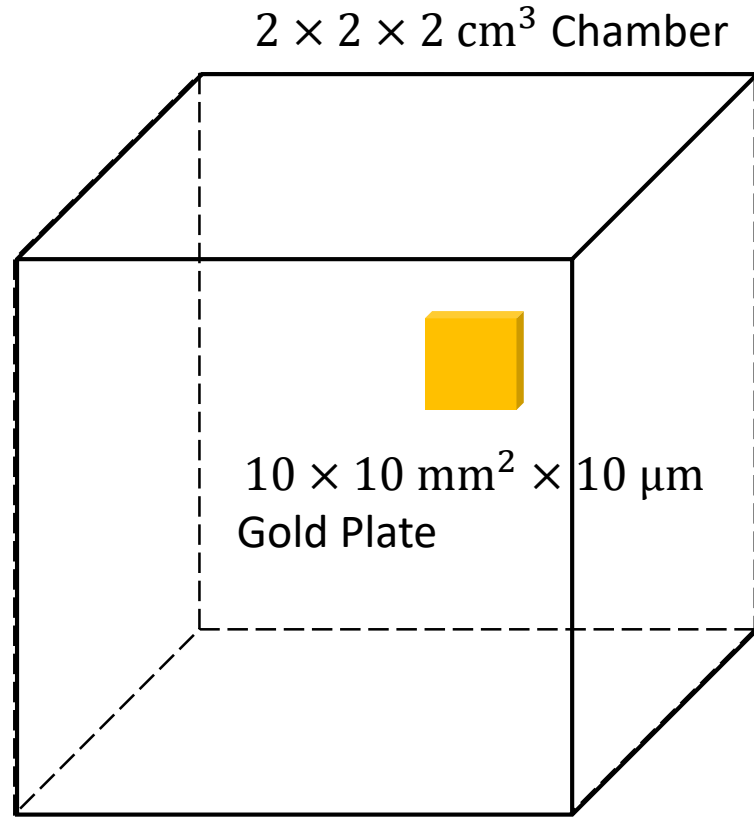


No more virtual
space setting

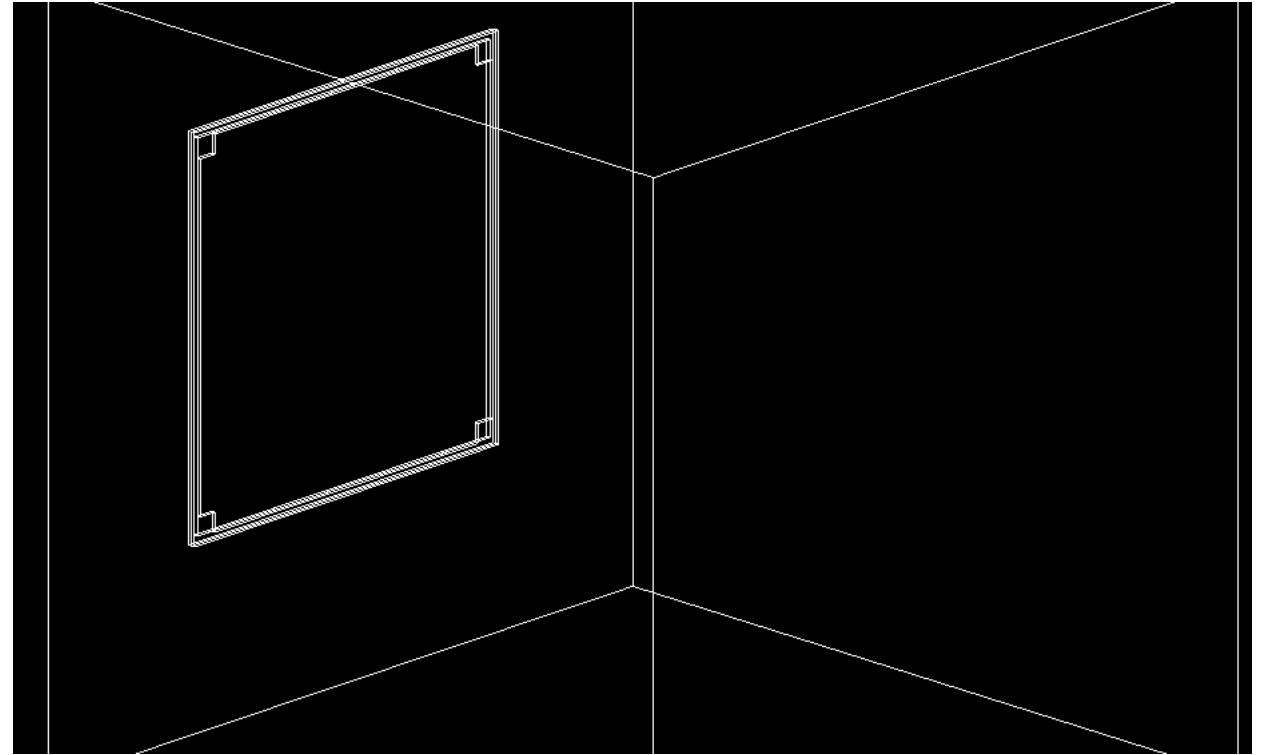


20- μm -thick lead protector

Geant4 Simulation

Triton Implantation [742/1000000]

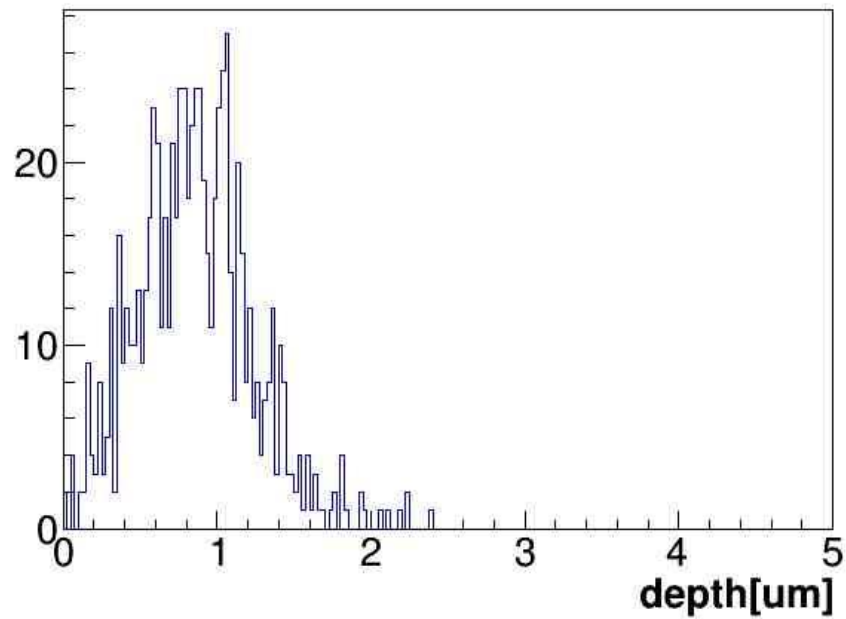


Triton Implantation [4930/10000000]

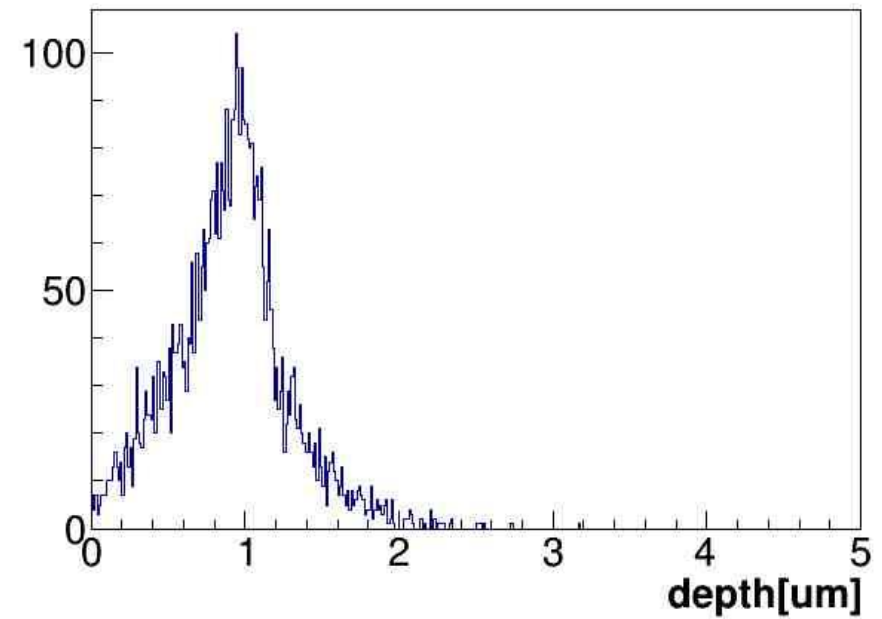


0.0742% $\rightarrow$ 0.0493 %

Geant4 Simulation


Electron absorption (fully absorbed-4930)

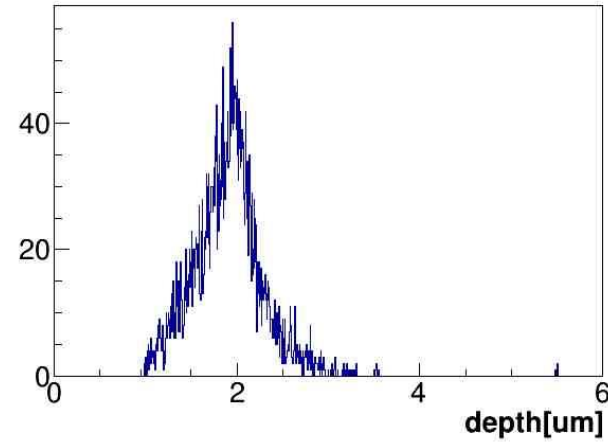

Electron absorption (fully absorbed)

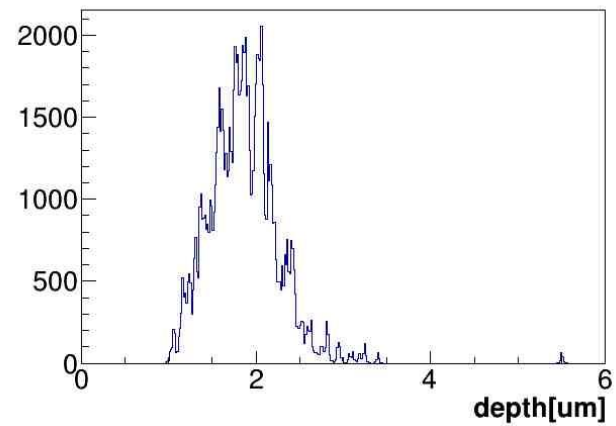

Electron absorption (fully absorbed-100000)

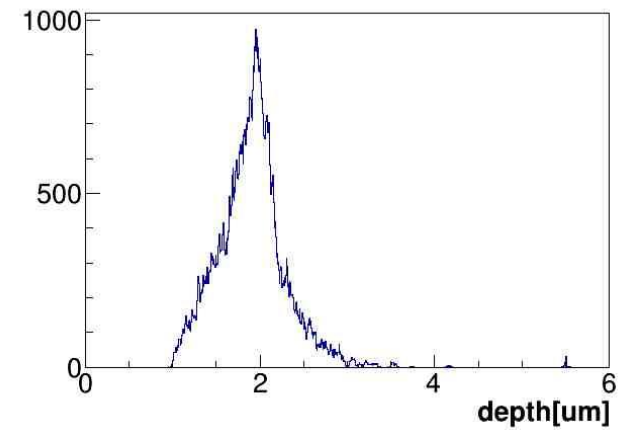

100000 iteration